


# Two Tank Diagram

Renewable Water Resources

Contact: Kim McDonald – Grease Control Inspector


864-299-4000 ext. 224

## Top Outside View

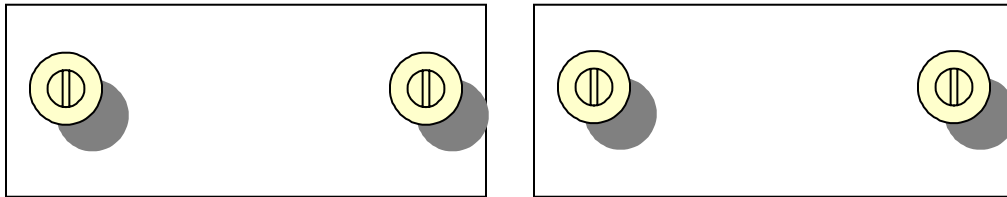

**Manhole covers must be positioned over inlet and outlet piping for each tank**

## Side View

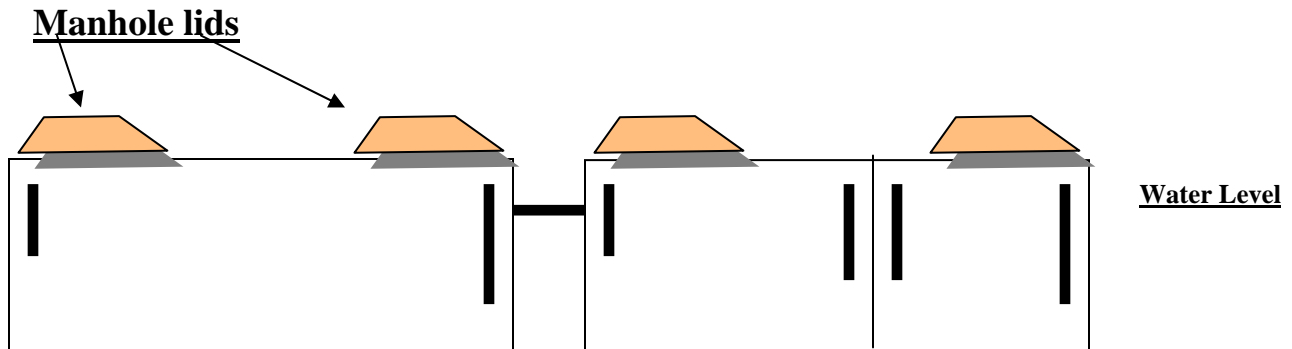

**1<sup>st</sup> Tank** – Un baffled – Manhole covers over both inlet and outlet piping  
Outlet pipe is 18-20” off bottom

**2<sup>nd</sup> Tank** – Baffled – Manhole covers over inlet and out piping,  
cleanouts over piping in baffle  
Outlet tee on 2<sup>nd</sup> tank must be 6” vertical, 18-20” off bottom